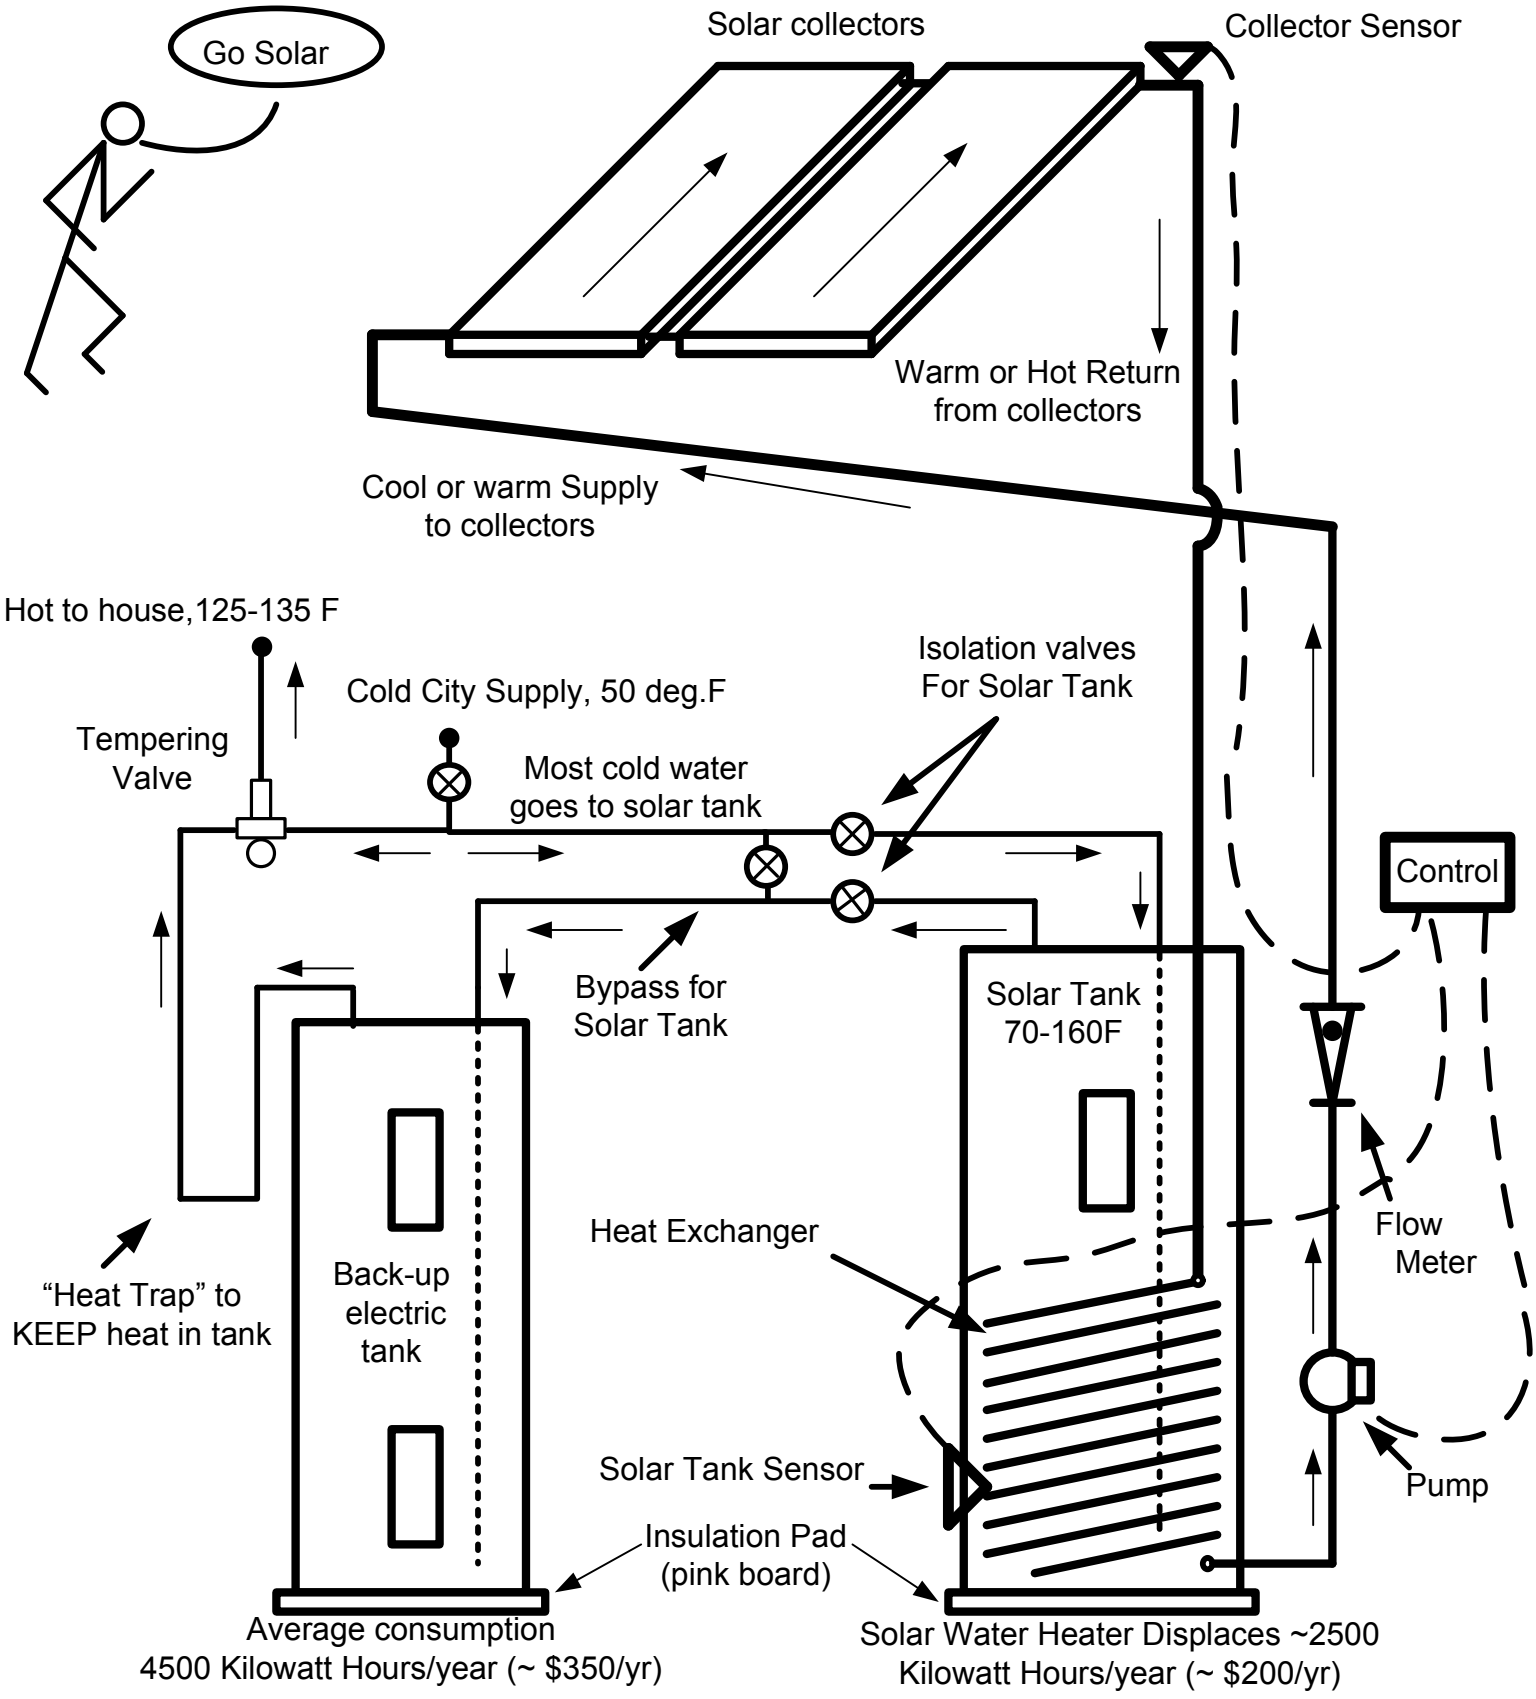“Configuration” of an Active-Closed Loop Glycol System